


Wastewater Utility 2022 Monthly Report



December 2022

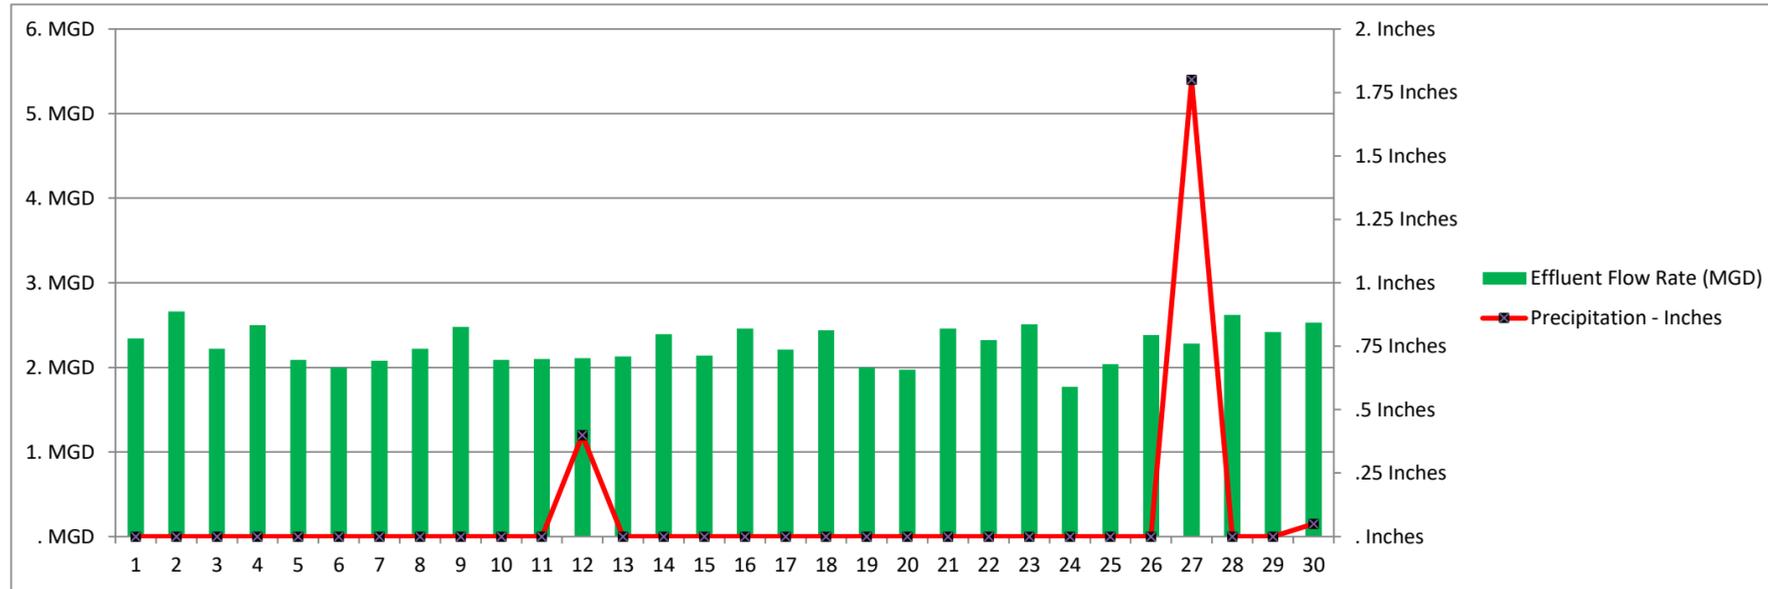

Month	January	February	March	April	May	June	July	August	September	October	November	December	Total
Total MG Treated Effluent 2022	107.08	132.88	140.54	120.85	123.71	86.77	72.59	84.83	81.02	69.45	67.96	77.22	1164.9
Total MG Treated Effluent 2021	93.67	91.88	123.06	84.84	99.19	104.57	134.73	79.89	90.88	113.92	84.24	123.59	1224.46
Total Monthly Precipitation 2022	1.97	5.87	4.90	4.52	7.72	2.05	2.43	6.55	3.13	1.41	2.25	3.58	46.38
2022 Monthly Percent Capacity Actual Design Flow 4.0 MGD	86%	119%	113%	101%	100%	72%	59%	68%	68%	56%	57%	62%	80%

Sewer Crew Activities	Plant Crew Activities
<ol style="list-style-type: none"> 1. Performed 14 lateral inspections. 2. Completed routine maintenance and lift station checks. 3. Responded to 3 service calls. 4. Cleaned 550' of sanitary mainlines. 5. Worked on clearing trees and brush at the Davis Road site. 6. Helped pull raw influent pump at the WWTP. 7. Repaired 7 catch basins. 8. Worked on cleaning all catch basins city wide with vac truck and inspecting structures. 	<p style="text-align: center;">Sludge Pressed / Gallons: 703,700</p> <p>Plant Operations and Maintenance:</p> <ol style="list-style-type: none"> 1. Completed required monthly maintenance. 2. Hauled out 385 tons of bio-solids. 3. Installed new plant water pump #2. 4. Repaired garage door in office building basement. 5. Primary Sludge Pump #1 stopped working; ordered repair parts. Still offline waiting for parts to be delivered.

Monthly Overtime					
WWTP Operators			Collection System Operators		
Scheduled: weekends, holidays	Emergency Call Ins	Other: Snow Removal	Unscheduled	Emergency Call Ins	Other: Snow Removal
49	6	0	1	4	7
Total Dept. Overtime:		67			