


# Wastewater Utility 2023 Monthly Report



February 2023

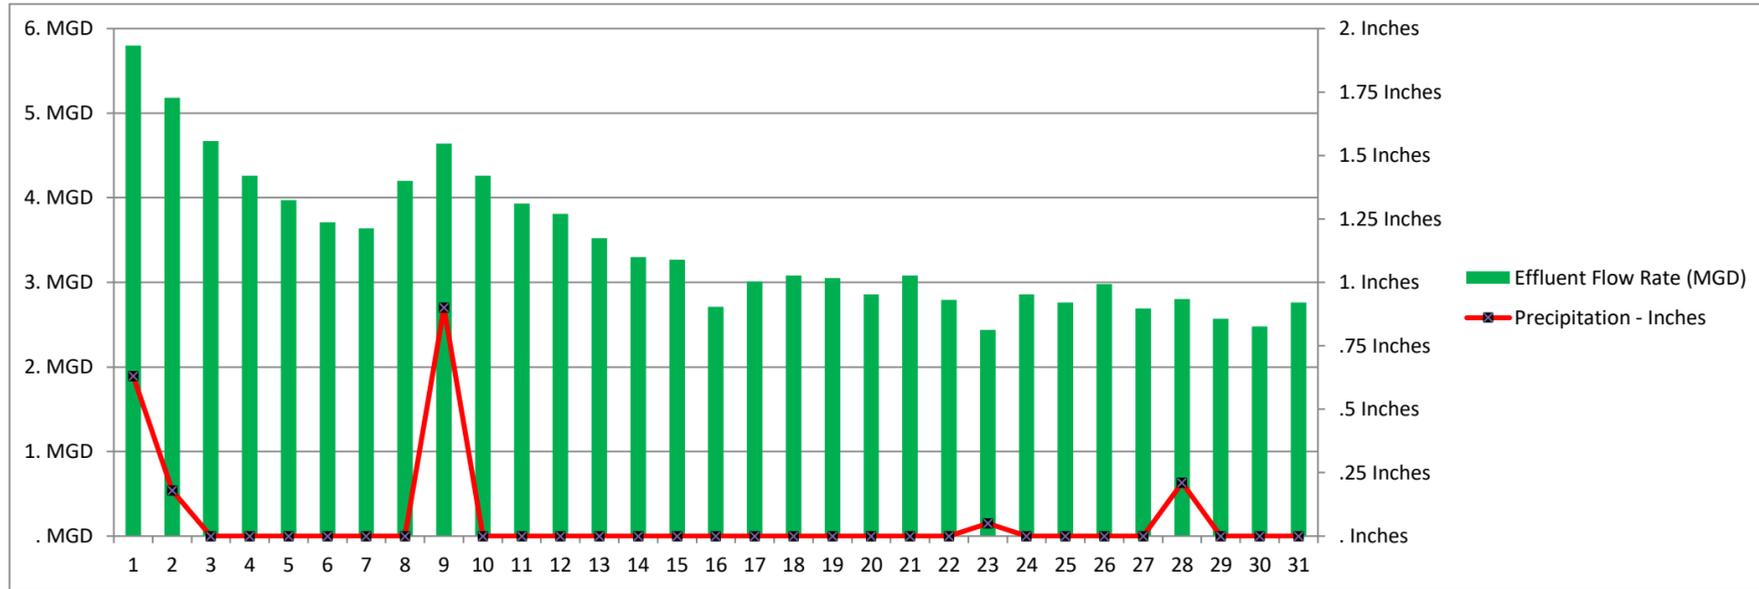

Month	January	February	March	April	May	June	July	August	September	October	November	December	Total
<b>Total MG Treated Effluent 2023</b>	<b>119.40</b>	<b>96.16</b>											<b>215.56</b>
Total MG Treated Effluent 2022	107.08	132.88	140.54	120.85	123.71	86.77	72.59	84.83	81.02	69.45	67.96	77.22	1164.90
<b>Total Monthly Precipitation 2023</b>	<b>3.40</b>	<b>2.29</b>											<b>5.69</b>
Total Monthly Precipitation 2022	1.97	5.87	4.9	4.52	7.72	2.05	2.43	6.55	3.13	1.41	2.25	3.58	46.38
2023 Monthly Percent Capacity Actual Design Flow 4.0 MGD	96%	86%											91%

Sewer Crew Activities	Plant Crew Activities
<ol style="list-style-type: none"> <li>1. Performed 7 lateral inspections.</li> <li>2. Completed routine maintenance and lift station checks.</li> <li>3. Responded to 7 service calls.</li> <li>4. Cleaned 950 feet of mainlines.</li> <li>5. Continued cleaning and jetting catch basins.</li> <li>6. Repaired/replaced 1 catch basin.</li> <li>7. Completed the rehab and repairs on the Crider's lift station.</li> <li>8. Maxim Automation replaced the level transducer at the Box Factory lift station.</li> <li>9. Continued cleaning up the area around the FOP and Police training area.</li> <li>10. Assisted with replacing roof on the chemical building (WWTP).</li> <li>11. Working on getting grease trap info updated and all grease traps inspected.</li> </ol>	<p style="text-align: center;"><b>Sludge Pressed / Gallons: 1,348,200</b></p> <p><b>Plant Operations and Maintenance:</b></p> <ol style="list-style-type: none"> <li>1. Completed required monthly maintenance.</li> <li>2. Hauled out 1419 tons of bio-solids.</li> <li>3. Had the loader serviced.</li> <li>4. Replaced roof on chemical building.</li> <li>5. Finished repairs on primary sludge pump #1 and put back into service.</li> <li>6. Buckeye Power Sales serviced all generators.</li> <li>7. Met with IDEM Inspector on 2/21/23 for plant inspection.</li> <li>8. Re-installed raw pump #1, but still had some issues. Xylem on-site to diagnose and realized the impeller was not the correct size. Had to order a different impeller.</li> </ol>

Monthly Overtime					
WWTP Operators			Collection System Operators		
Scheduled: weekends,	Emergency Call Ins	Other: Snow Removal	Unscheduled	Emergency Call Ins	Other: Firewood
35	0		12	6	13.5
<b>Total Dept. Overtime:</b>		<b>66.5</b>			