



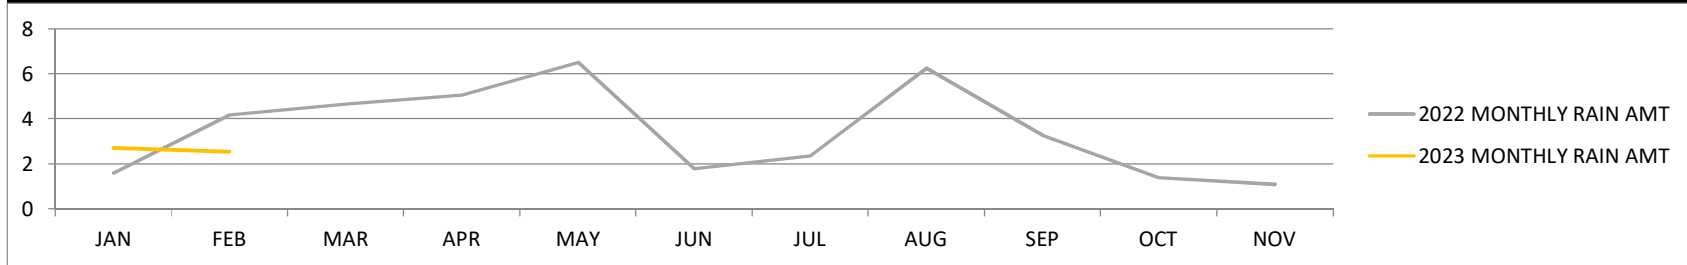

Water Utility

2023 Monthly Report

March

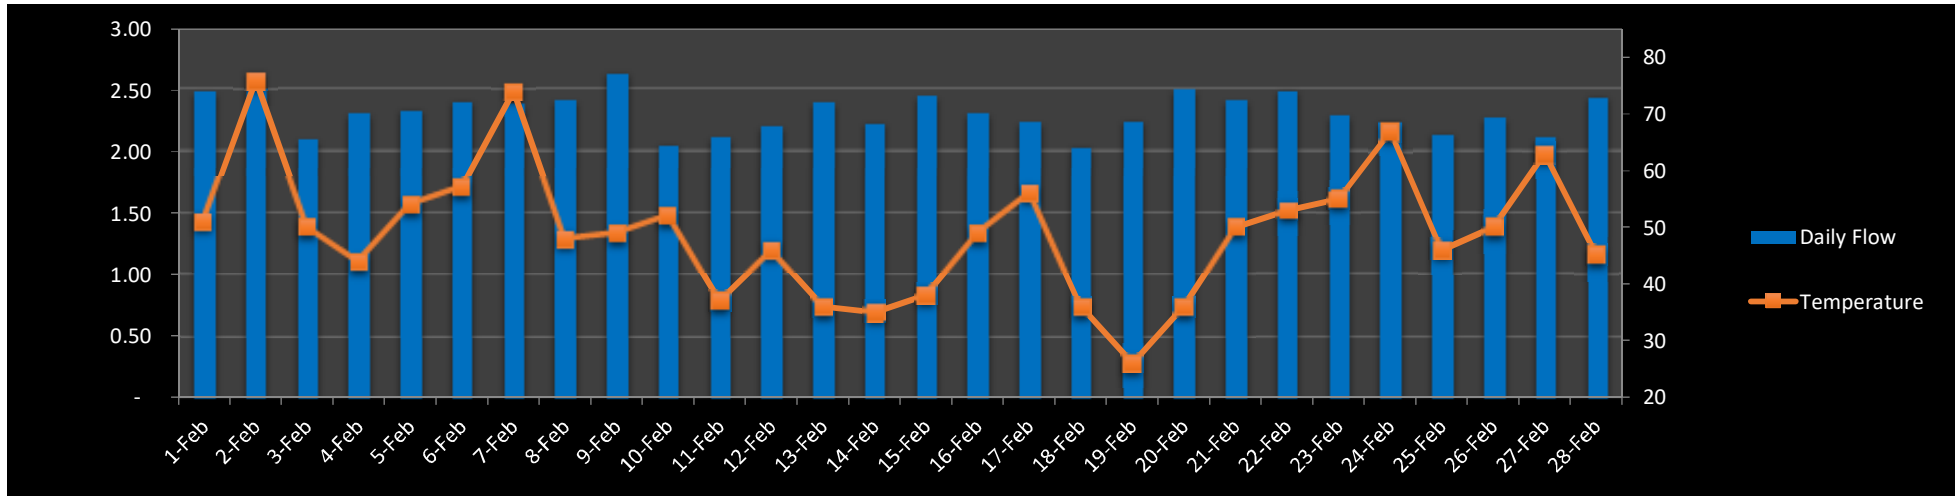

| |
|----------------------------------|
| Normal production |
| Single main break / service leak |
| Mutliple Main breaks |
| Fire |
| Flushing |

Treatment

Water produced
Water Sold
Storage
% Unaccounted
Max Day
Prev Month connections:
Current Month connections:
average distirbution chlorine
AverageTreatment Phosphate
Average Treatment Iron
Average Treatment Maganese

| |
|-------|
| 71.34 |
| 135% |
| 2.63 |
| 0.76 |
| 1.39 |
| 0.080 |
| 0.135 |

OT, non- & Scheduled

| |
|----------------------------------|
| Overtime, Non scheduled |
| Overtime, scheduled |
| Non-scheduled OT events |
| ECO- Customer Service |
| ECO- Distribution |
| ECO- Treatment |
| ECO- Fire response / support |
| Scheduled overtime events |
| Distribution Project work |
| Plant Operations |
| Conference/training |

Work Order summary

| | | | |
|------|---|-----|-----------------|
| 34 | Construction / Repair | 7 | I&C maintenance |
| 79 | Performed Leak Notifications | 0 | |
| | After hours Customer Service calls | 15 | |
| 14 | Hydrant painting | 17 | |
| 17 | GIS Modifications | 51 | |
| 3 | Planning reviews and Technical Assistance | | |
| 0 | Working on Well site reconnaissance | 1 | |
| | Valve Maintenance | 1 | |
| 23 | Hydrant flushing | 247 | |
| 40 | Sampling | 32 | |
| 14.5 | Daily ops tasks | 60 | |