



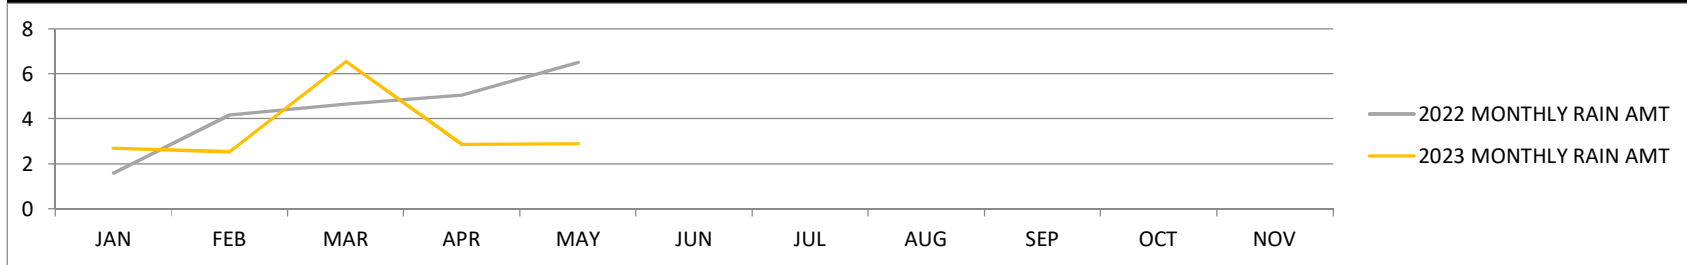

Water Utility

2023 Monthly Report

MAY

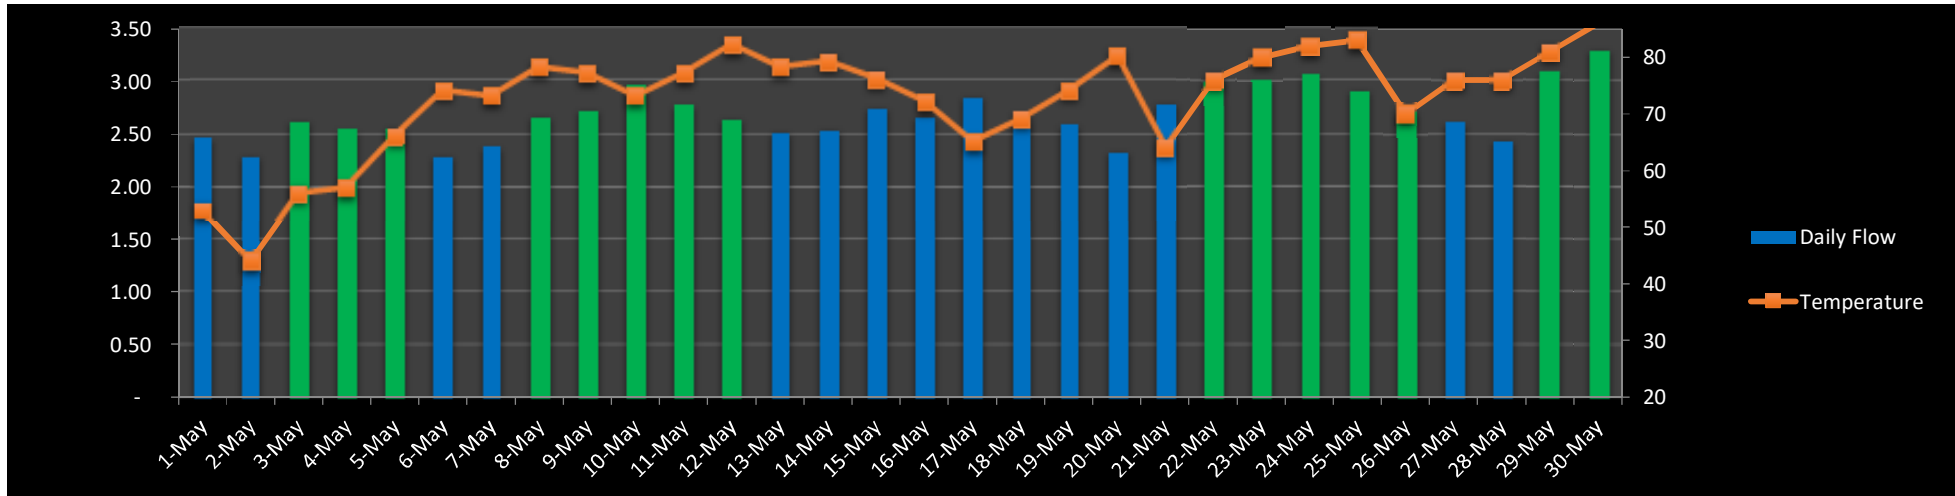

Normal production
Single main break / service leak
Mutliple Main breaks
Fire
Flushing

Treatment

Water produced	
Water Sold	
Storage	
% Unaccounted	*
Max Day	
Prev Month connections:	
Current Month connections:	
Average distirbution chlorine	
Average Distribution Phosphate	
Average Treatment Iron	
Average Treatment Maganese	

92.26
63.30
124%
31%
3.30
9404
9426
0.64
1.45
0.095
0.029

OT, non- & Scheduled

Overtime, Non scheduled
Overtime, scheduled
Non-scheduled OT events
ECO- Customer Service
ECO- Distribution
ECO- Treatment
OT- Main break repair
Scheduled overtime events
Distribution Project work
Plant Operations
Conference/training

Work Order summary

52.5	Construction / Repair		I&C maintenance
49.75	Performed Leak Notifications		
12	Hydrant painting	42	
8	GIS Modifications	14	
4	Riley Lit Trail Project	1.5	
8.5	Valve Maintenance	8	
	Filter Diagonsic sampling	28	
4.5	Hydrant flushing	214	
0	Sampling	45	
0	Daily ops tasks	62	