



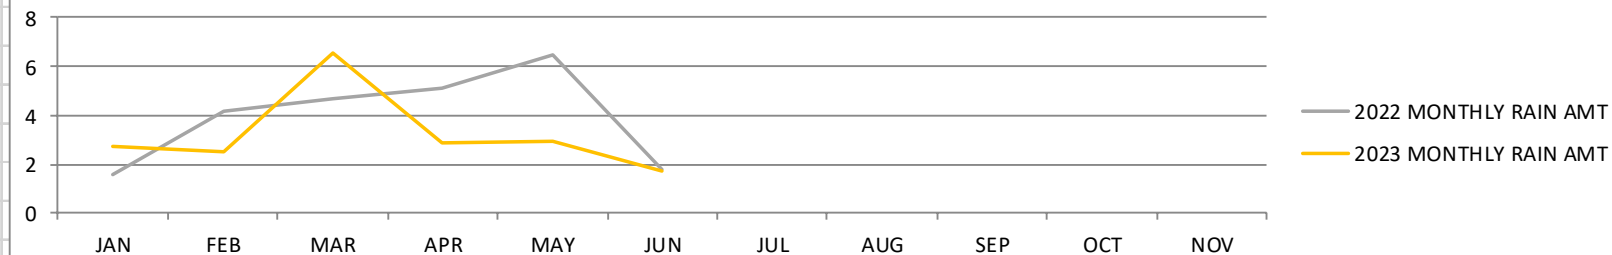

# Water Utility

## 2023 Monthly Report

JUNE

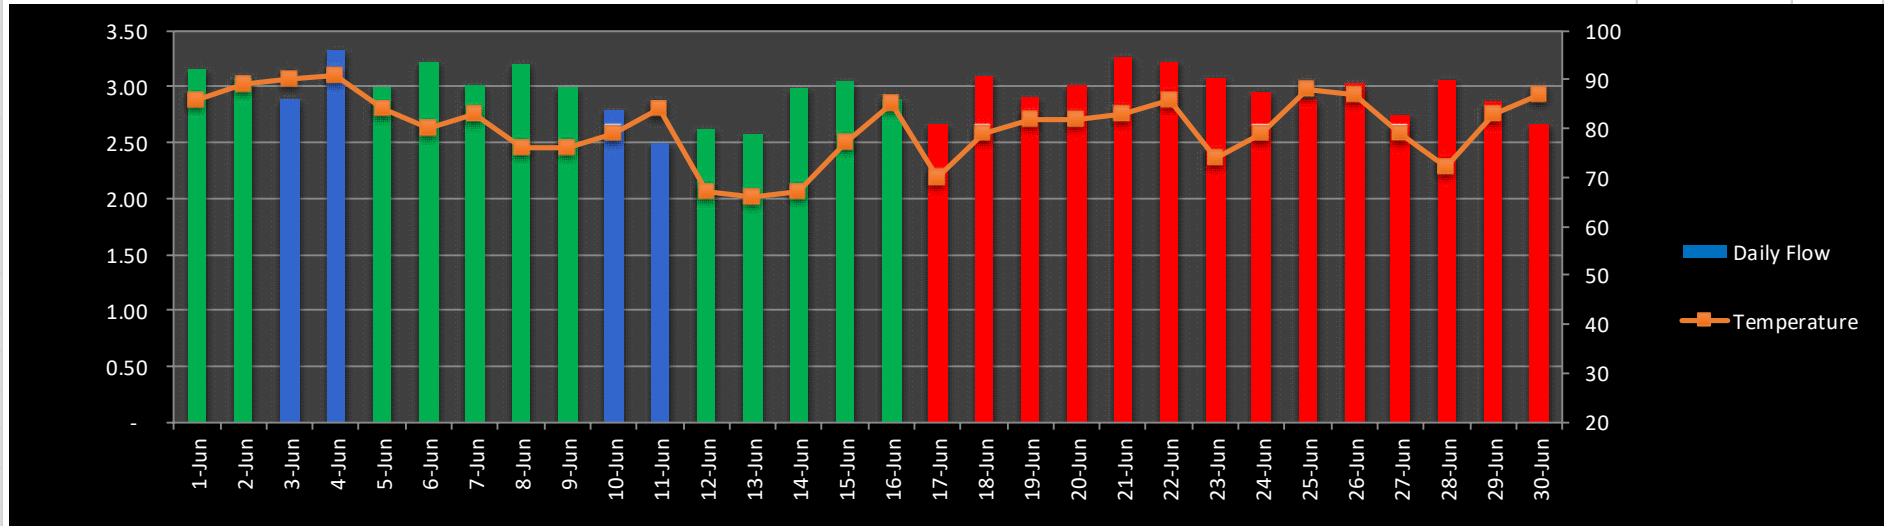

Normal production
Single main break / service leak
Mutliple Main breaks
Fire
Flushing
Drought Condition

Treatment			OT, non- & Scheduled			Work Order summary				
Water produced		97.67	Overtime, Non scheduled		15	Construction / Repair	7		Storm damage cleanup	1
Water Sold		66.49	Overtime, scheduled		32	Performed Leak Notifications	0		LCRR Inventory	7251
Storage		125%	Non-scheduled OT events							
% Unaccounted		32%	ECO- Customer Service		15	Hydrant painting	19			
Max Day		3.33	ECO- Distribution			GIS Modifications	27			
Prev Month connections:		9426	ECO- Treatment			Riley Lit Trail Project	10			
Current Month connections:		9505	OT- Main break repair			Valve Maintenance	14			
Average distribution chlorine		0.68	Scheduled overtime events			Filter Diagnostic sampling	25			
Average Distribution Phosphate		1.52	Distribution Project work		4	Hydrant flushing	55			
Average Treatment Iron		0.10	Plant Operations		32	Sampling	62			
Average Treatment Maganese		0.028	Conference/training			Daily ops tasks	60			