


Wastewater Utility 2023 Monthly Report

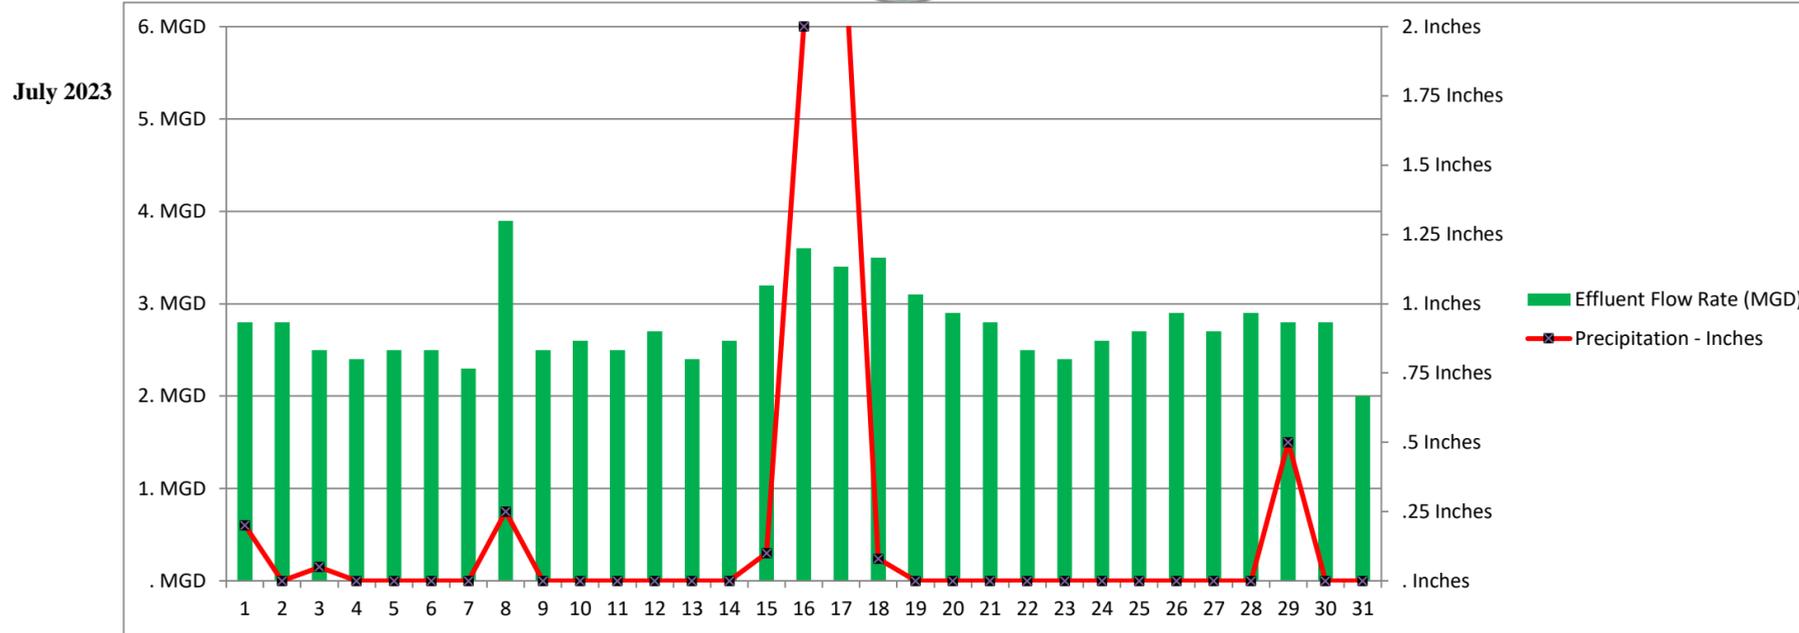

Month	January	February	March	April	May	June	July	August	September	October	November	December	Total
Total MG Treated Effluent 2023	119.40	96.16	164.80	95.29	88.73	67.40	85.80						717.58
Total MG Treated Effluent 2022	107.08	132.88	140.54	120.85	123.71	86.77	72.59	84.83	81.02	69.45	67.96	77.22	1164.90
Total Monthly Precipitation 2023	3.40	2.29	7.39	2.40	1.32	1.39	5.68						23.87
Total Monthly Precipitation 2022	1.97	5.87	4.9	4.52	7.72	2.05	2.43	6.55	3.13	1.41	2.25	3.58	46.38
2023 Monthly Percent Capacity Actual Design Flow 4.0 MGD	96%	86%	133%	79%	72%	56%	69%						84%

Sewer Crew Activities	Plant Crew Activities
<ul style="list-style-type: none"> 1. Performed 12 lateral inspections. 2. Completed routine lift station checks. 3. Responded to 4 service calls. 4. Cleaned 12,235 feet and inspected 1,107 feet of sanitary mainlines. 5. Repaired 1 sanitary manhole and replaced 1 sanitary manhole. 6. Repaired/replaced 45 feet of sanitary mains. 7. Assisted with the landscaping cleanup at the Animal Management facility. 8. Inspected sink hole at Fire Station 2. 9. Clean catch basins throughout the City. 10. Responded to an oil spill near IAF/Hastings pond. 11. Assisted P&L with 2 damaged poles on Davis Road at the construction entrance. 	<p style="text-align: center;">Sludge Pressed / Gallons: 1,283,400</p> <p>Plant Operations and Maintenance:</p> <ul style="list-style-type: none"> 1. Completed required monthly maintenance. 2. Hauled 0 tons of Class A bio-solids to farmers and 207 tons of pressed sludge to the landfill. 3. Changed chlorine pump head and eventually had to change out the pump. 4. Replaced the disconnect breaker for Blower #1. 5. Replaced the air intake filter on Blower #3 and added a pre-filter due to the amount of dust/dirt from construction activities. 6. Adjusted the run settings for Acti-Flow again due to continued operational issues during storm events. 7. Ordered a new top belt for Belt Press #2. 8. Cleaned final clarifiers. 9. Cleaned dissolved oxygen sensors in the aeration tanks. 10. Ordered parts to repair primary sludge pump #3 again. Drained, cleaned, and inspected primary #3 since it is not operational.

Monthly Overtime					
WWTP Operators			Collection System Operators		
Scheduled: weekends, holidays	Emergency Call Ins	Other	Unscheduled	Emergency Call Ins	Other
51.5	14.5	0	25.5	31	0
Total Dept. Overtime:		122.5			