



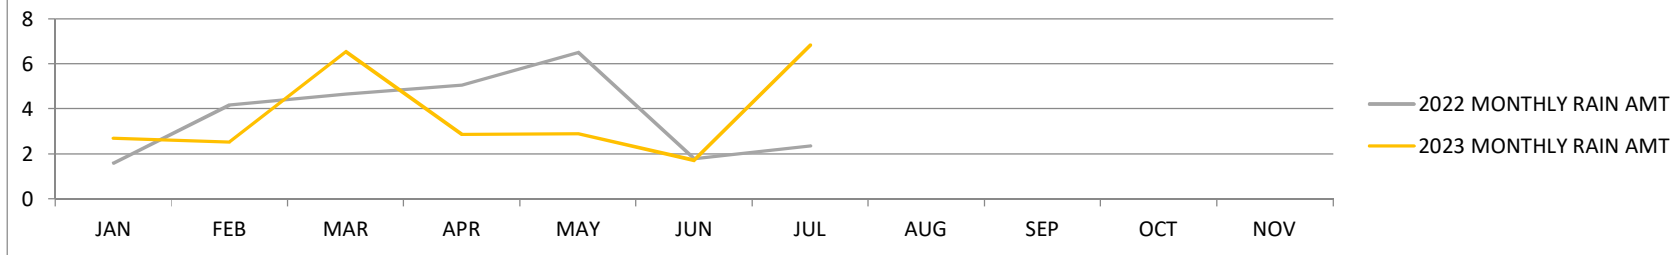

2023 Monthly Report

Water Utility

July

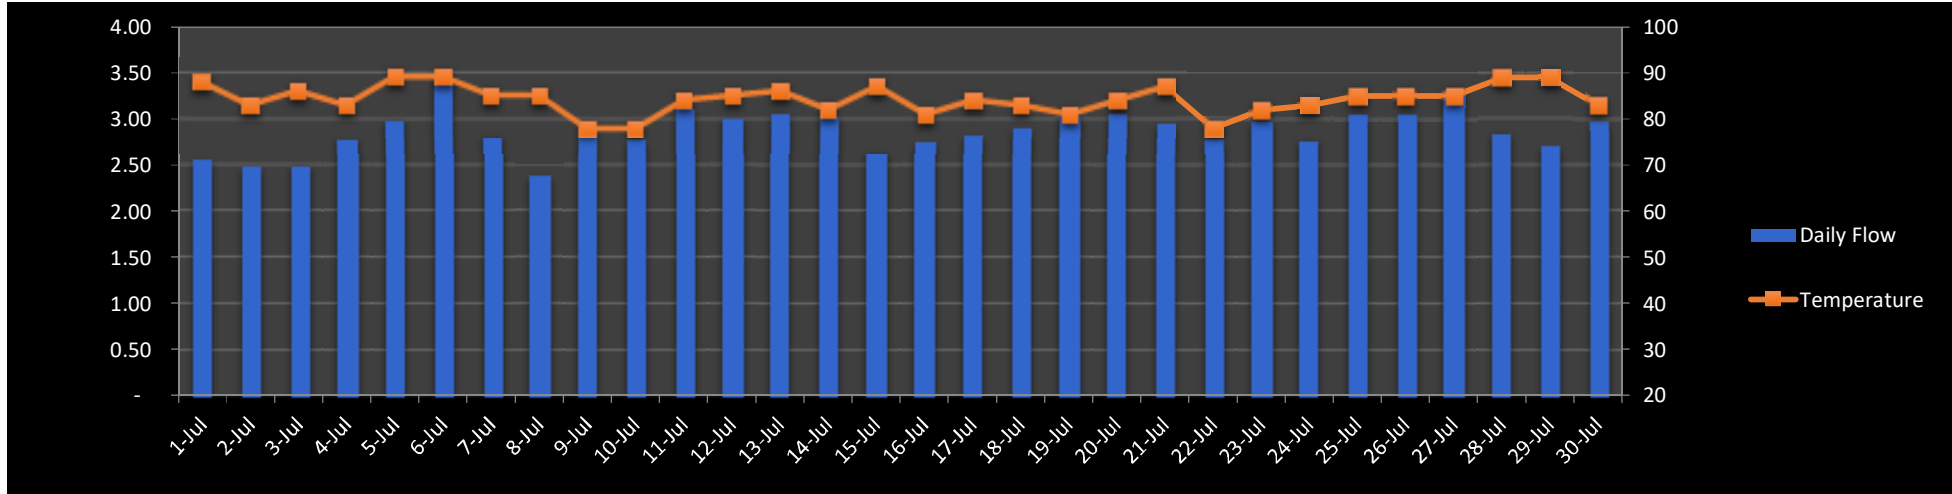

Normal production
Single main break / service leak
Mutliple Main breaks
Fire
Flushing
Drought Condition

Treatment

Water produced
Water Sold
Storage
% Unaccounted
Max Day
Prev Month connections:
Current Month connections:
Average distirbution chlorine
Average Distribution Phosphate
Average Treatment Iron
Average Treatment Maganese

89.47
81.15
127%
9%
3.43
9505
9542
0.60
1.59
0.05
0.035

OT, non- & Scheduled

Overtime, Non scheduled
Overtime, scheduled

Non-scheduled OT events

ECO- Customer Service
ECO- Distribution
ECO- Treatment

Scheduled overtime events

Distribution Project work
Plant Operations
Conference/training

Work Order summary

31.5	Construction / Repair
58.25	Performed Leak Notifications
10	Hydrant painting
17.5	GIS Modifications
4	Riley Lit Trail Project
	Valve Maintenance
	Filter Diagnostic sampling
2.25	Hydrant flushing
56	Sampling
5	Daily ops tasks

6	Storm damage cleanup
0	LCRR Inventory done
12	
3	
4	
0	
2	
0	
40	
60	

7486
2056