
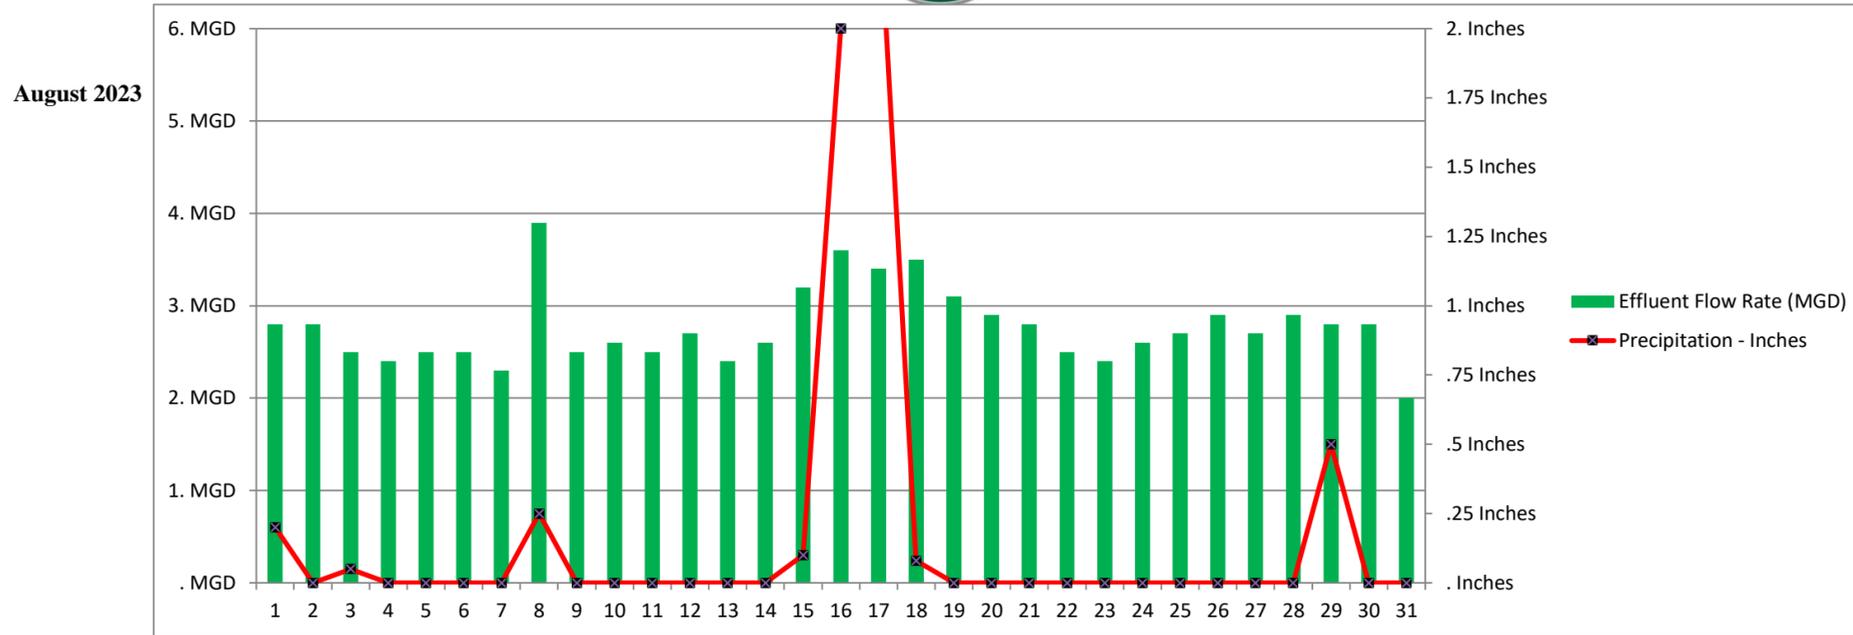


Wastewater Utility 2023 Monthly Report



Month	January	February	March	April	May	June	July	August	September	October	November	December	Total
Total MG Treated Effluent 2023	119.40	96.16	164.80	95.29	88.73	67.40	85.80	89.80					807.38
Total MG Treated Effluent 2022	107.08	132.88	140.54	120.85	123.71	86.77	72.59	84.83	81.02	69.45	67.96	77.22	1164.90
Total Monthly Precipitation 2023	3.40	2.29	7.39	2.40	1.32	1.39	5.68	5.03					28.90
Total Monthly Precipitation 2022	1.97	5.87	4.9	4.52	7.72	2.05	2.43	6.55	3.13	1.41	2.25	3.58	46.38
2023 Monthly Percent Capacity Actual Design Flow 4.0 MGD	96%	86%	133%	79%	72%	56%	69%	72%					83%

Sewer Crew Activities	Plant Crew Activities
<ol style="list-style-type: none"> 1. Performed 10 lateral inspections. 2. Completed routine lift station checks. 3. Responded to 3 service calls. 4. Completed video inspection of 1515' of sanitary and 150' of storm mains. 5. Repaired/replaced 20' of sanitary and 135' of storm mains. 6. Installed 2 storm catch basins. 7. Worked on re-routing and filling in the pond on Davis Road behind the Village Pantry. 8. Completed existing grease trap inspections; inspected 1 new grease trap at Vita Development. 9. Repaired concrete around manholes on 4th Street and Franklin Street. 	<p style="text-align: center;">Sludge Pressed / Gallons: 709,300</p> <p>Plant Operations and Maintenance:</p> <ol style="list-style-type: none"> 1. Completed required monthly maintenance. 2. Hauled 0 tons of Class A bio-solids to farmers and 291 tons of pressed sludge to the landfill. 3. Repaired the alum supply lines in the acti-flow building, they had a couple minor leaks. 4. Replaced the belt on one of the acti-flow sand pumps. 5. Replaced the upper and lower belts on the belt press. 6. Replaced the seal on the upper wash box of the belt press. 7. Completed the annual preventive maintenance on blower #3. 8. Replaced the start/stop timers on the grit removal system in headworks. 9. Replaced the diaphragm in primary sludge pump #2. 10. Maxim Automation in to troubleshoot and repair acti-flow control panel: had to replace the logic module in the touch panel.

Monthly Overtime					
WWTP Operators			Collection System Operators		
Scheduled: weekends, holidays	Emergency Call Ins	Other	Unscheduled	Emergency Call Ins	Other
46	4	0	11	4	0
Total Dept. Overtime:		65			