




## 2023 Monthly Report

## Water Utility

October

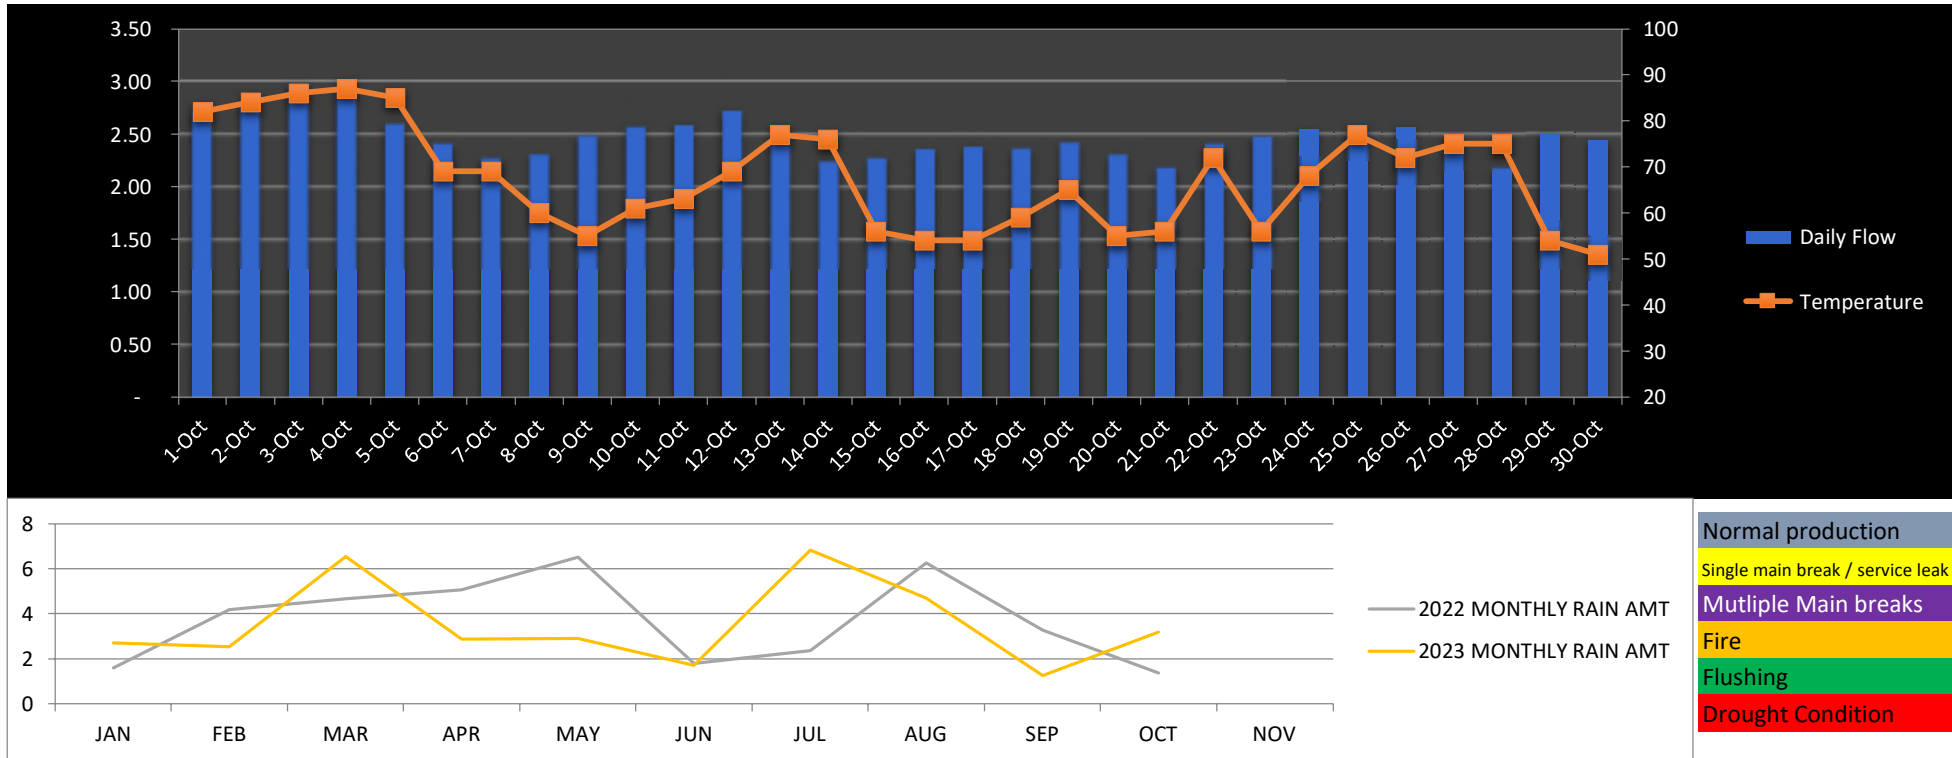

### Treatment

Water produced  
Water Sold  
Storage  
% Unaccounted  
Max Day  
Prev Month connections:  
Current Month connections:  
Average distribution chlorine  
Average Distribution Phosphate  
Average Treatment Iron  
Average Treatment Manganese

76.49
68.86
116%
10%
2.97
9588
9601
0.87
1.58
0.04
0.038

### OT, non- & Scheduled

Overtime, Non scheduled  
Overtime, scheduled  
Overtime taken as Comp time  
**Non-scheduled OT events**  
ECO- Customer Service  
ECO- Distribution  
ECO- Treatment  
**Scheduled overtime events**  
Distribution Project work  
Plant Operations  
Conference/training

### Scheduled overtime events (cont)

18.75
333.00
61.75
16
0
2.75
54.5
63
9.5

Riley Festival  
Trunk or Treat  
**Work Order summary**  
Construction / Repair  
Hydrant painting  
GIS Modifications  
Customer Service Calls  
Leak Notifications  
LCRI Identification  
Sampling  
Daily ops tasks

187.50
6
14
15
22
16
0
8525
20
62

Filter media inspection  
Yearly fire inspections  
Updated all SDS manuals  
Fit testing for the operators  
Backflow testing  
Safety signage replacement  
Special Sampling  
Mowed all facilities