



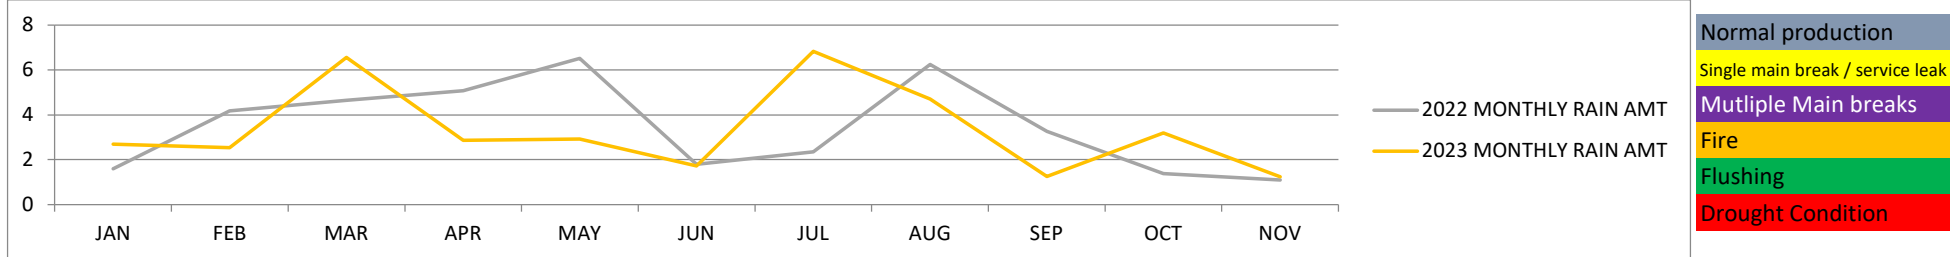

2023 Monthly Report

Water Utility

November

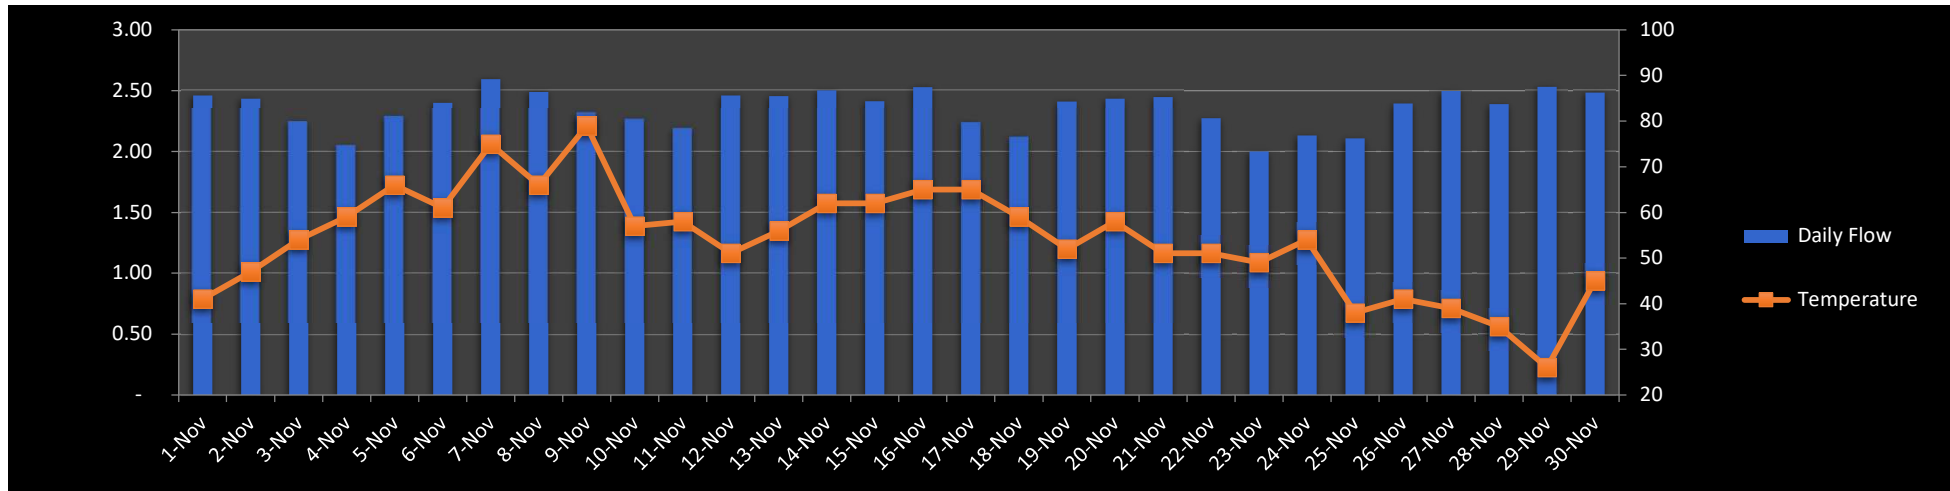

- Normal production
- Single main break / service leak
- Multiple Main breaks
- Fire
- Flushing
- Drought Condition

Treatment

Water produced
Water Sold
Storage
% Unaccounted
Max Day
Prev Month connections:
Current Month connections:
Average distribution chlorine
Average Distribution Phosphate
Average Treatment Iron
Average Treatment Manganese

70.58
65.47
104%
7%
2.60
9601
9505
0.68
1.52
0.07
0.037

OT, non- & Scheduled

Overtime, Non scheduled
Overtime, scheduled
Overtime taken as Comp time
Non-scheduled OT events
ECO- Customer Service
ECO- Distribution
ECO- Treatment
Scheduled overtime events
Distribution Project work
Plant Operations
Conference/training

29.00
77.00
11.00
15
2
0
4
2
0

Scheduled overtime events (cont)

Construction / Repair
Hydrant painting
GIS Modifications
Customer Service Calls
Leak Notifications
LCRI Identification
Sampling
Daily ops tasks

3
0
1
8
0
8596
20
60

Work Order summary

Riley Lit trail work
Ricks ave
Six special sampling
4th Qtr TTHM/HAA5
Radionuclides
Cleaning of Well 1-1
Drill Test well 1-4
50 Year Service NWS
Control systems upg