

GREENFIELD INDIANA

Engineering Department

*Waste Water Treatment Facility
& Collection System Maintenance*


300 South State Street - Greenfield, Indiana 46140

317-462-8530

Fax 317-462-8529

RECOMMENDED MINIMUM 1000 GALLON GREASE TRAP REQUIREMENTS

WATER TIGHT LIDS

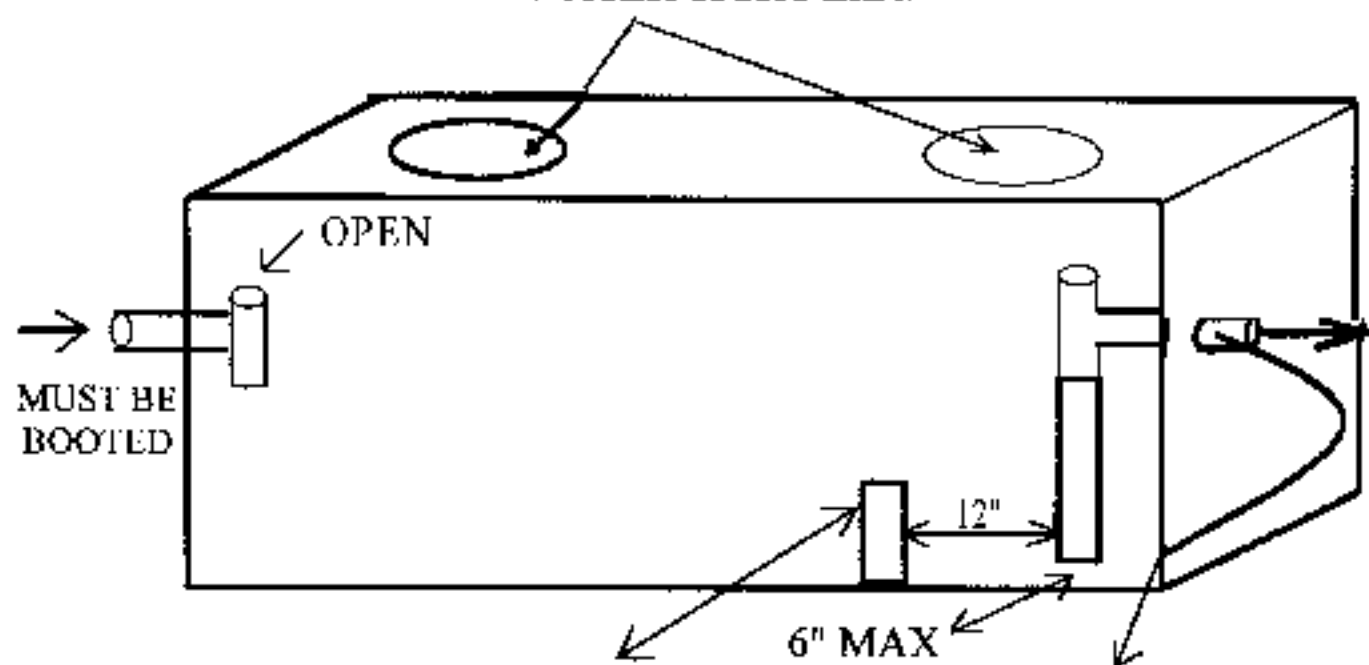

RECOMMENDED SEDIMENT (SLUDGE)
RETAINING WALL 12-18" IN HEIGHT

6" MINIMUM OR
EXISTING SIZE
MUST BE BOOTED

- 4" MINIMUM WALL THICKNESS
- 4" COMPACTED STONE BASE