


Wastewater Utility 2019 Monthly Report



October 2019

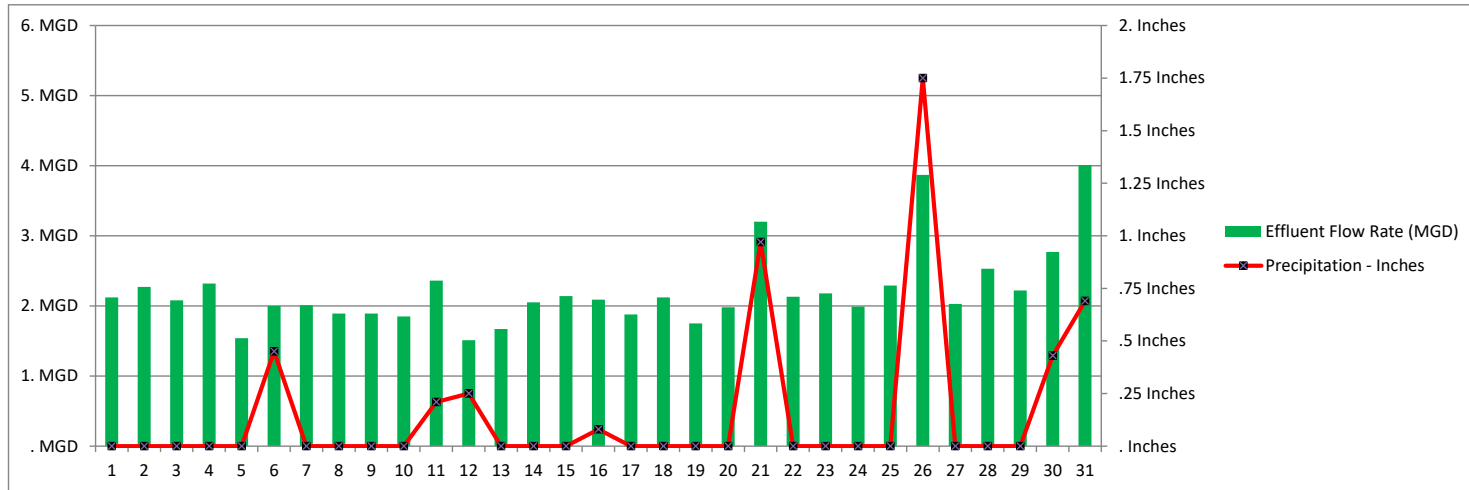

Month	January	February	March	April	May	June	July	August	September	October	November	December	Total
Total MG Treated Effluent 2019	123.30	138.30	122.91	154.54	127.04	152.68	92.70	78.41	62.48	68.74			1121.1
Total MG Treated Effluent 2018	91.20	125.71	114.45	126.25	75.78	85.60	98.27	115.29	132.71	79.28	120.06	97.73	1262.33
Total Monthly Precipitation 2019	2.24	6.52	4.89	6.58	7.77	10.09	6.95	3.34	0.26	4.83			53.47
2019 Monthly Percent Capacity Actual Design Flow 4.0 MGD	99%	123%	99%	129%	102%	127%	75%	63%	52%	55%			93%

Sewer Crew Activities

1. Performed 14 lateral inspections
2. Continued working on sewer rehabilitation project/OCRA; locating laterals and installing clean outs in preparation for lateral lining.
3. Completed semi-annual lift station maintenance.
4. Completed the Meridian Road storm water project
5. Repaired lateral at 524 S. State St. with help from Leonard Excavating.
6. Staked easement from McKenzie to Kroger.
7. Installed clean outs at Riley Park restrooms.
8. Jetted and CCTV at Redbud, Sycamore, Kirkpatrick Pl., W. 4th, completed McClellon inspections.
9. CCTV storm gutters at 313 S. State St. to ensure they weren't connected to sanitary.
10. Inspected and repaired storm at 2019 Justice.
11. Fixed and cleaned catch basins at West and North.

Plant Crew Activities

- Sludge Pressed / Gallons: 632,400**
- Plant Operations and Maintenance:**
1. Completed required monthly maintenance.
 2. Installed kick plates on tank railings.
 3. Replaced drive motor on circular clarifier; replaced power supply wires from breaker to the disconnect box: bad wire underground.
 4. Installed new pump in RAS station (Pump #3).
 5. Replaced motor coupler on blower #1
 6. Belt Press Feed Pump #1 failed and it was determined that it would too expensive to repair; waiting on quotes for a replacement pump.
 7. Shut down and winterized the disinfection system.