





# Water Utility 2020 Monthly Report

July

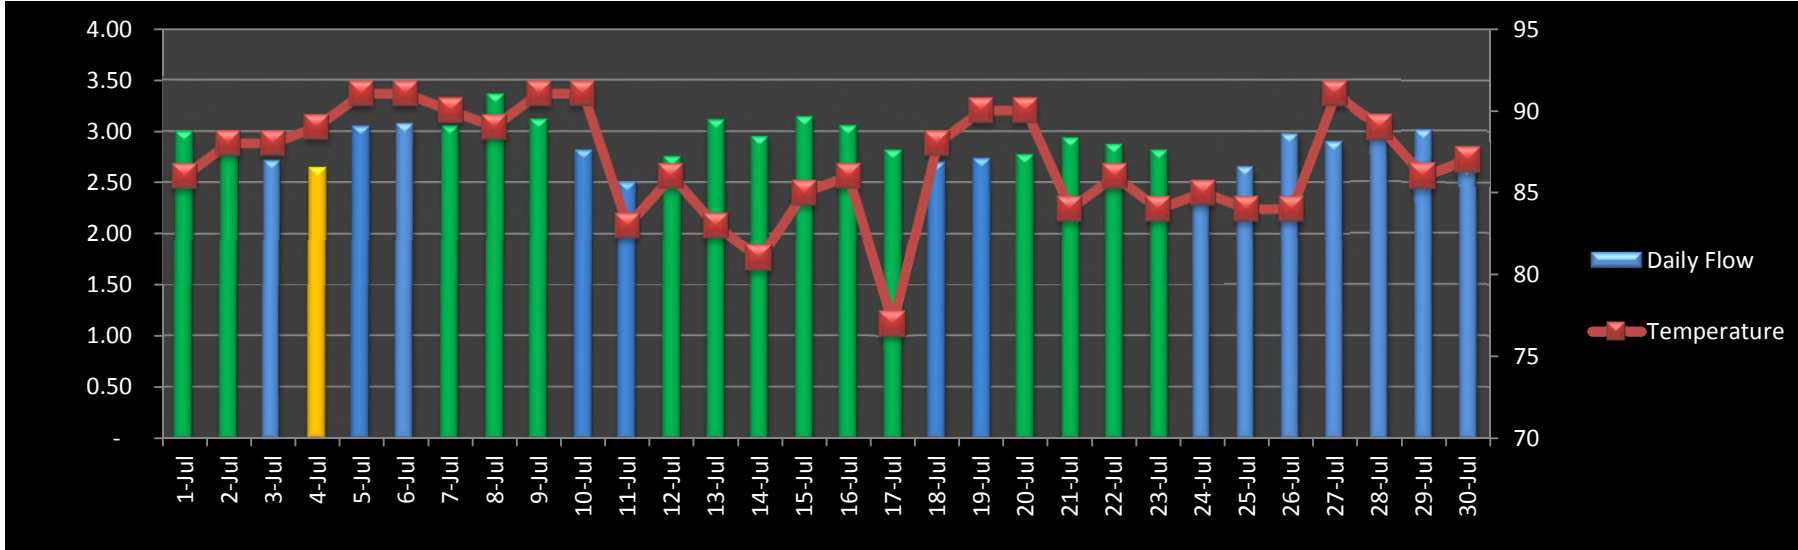

Month	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sept	Oct	Nov	Dec	Total	Normal production
Monthly water produced	67.64	63.02	64.05	57.98	67.37	80.69	89.14							
Monthly sold water	60.21	60.02	61.94	57.57	56.97	62.14	81.69							
% Accounted for water production	11%	5%	3%	1%	15%	13%	8%							
Total completed work orders	254	106	218	163	228	289	355							
Max day production	2.82	2.42	2.30	2.26	2.46	3.26	3.36							
Average storage + /(-)	20.1%	7.1%	2.2%	0.4%	8.5%	31.0%	33.1%							
2020 Precipitation totals	5.23	4.14	4.75	2.21	5.35	4.79	3.65							
2019 Precipitation totals	4.29	5.68	5.59	4.43	3.02	10.55	7.23							

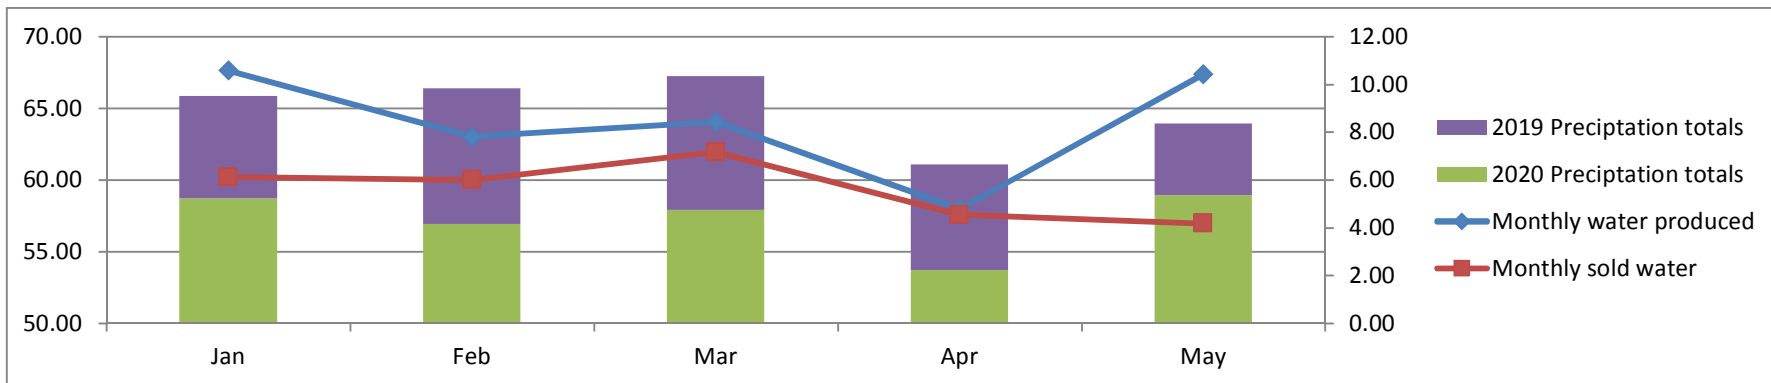



2020 Monthly Report

Water Utility

July



Work Type	Total	Complete	New Request	Work In Progress	Work Type	Total	Complete	New Request	Work In Progress
Assist Fire Department	1	1	0	0	Valve Maintenance - Plant	1	1	0	0
Assist Other Utilities	1	0	1	0	Valve Repair	4	2	2	0
Building Maintenance	1	1	0	0	Vehicle Inspection	3	3	0	0
Building Material Condition	4	4	0	0	Vehicle Maintenance	6	6	0	0
Check for Leak	5	5	0	0	<b>Mthly Work Order Total</b>	<b>373</b>	<b>355</b>	<b>15</b>	<b>3</b>
Construction Inspection	8	4	4	0	<u>Comments on operations</u>				
D.S. Sampling	10	10	0	0	Flushing program			6,018,000	gallons
Discolored Water	8	8	0	0				85	hours
Enclosure Material Condition	5	5	0	0	Maintenance and new construction			192	hydrants
Hydrant Flushing	125	124	1	0				46	valves
Hydrant Inspection	1	1	0	0	Valve program			2	
Hydrant Painting	34	34	0	0	Main breaks				
Hydrant Repair	2	1	1	0	Residential usage			7,981	customers
Hydrant Service	33	33	0	0				20	new accounts
Install New Service	7	6	0	1				<u>47,666,930</u>	gallons
Locate	2	0	0	2				<u>8,421,301</u>	more than June 2020
Low Pressure/Frozen Service	2	2	0	0	Commerical usage			607	customers
Main Break	2	2	0	0				-	new accounts
Map Correction Request	8	8	0	0				<u>33,829,619</u>	gallons
Meter Pit Inspection	32	32	0	0				<u>11,236,198</u>	more than June 2020
Misc - Plant	3	3	0	0	Lead and Copper Results	90th percentile	ACTION LEVEL		
Misc - Source	2	2	0	0		LEAD	1.8 ppb	15 ppb	
Pump Maintenance	1	0	1	0		COPPER	1.01 mg/l	1.3 mg/l	
Replace Hydrant	3	3	0	0	Back flow / Cross Connection	In Compliance	Out of compliance	labor hrs	
Replace/Repair Meter	1	1	0	0	699 total devices	593	106	60	
Retire Old Service	2	2	0	0				99.82%	
Turn Off	5	5	0	0					
Turn On	2	2	0	0					
Vac Out Valve Box	4	0	4	0					
Valve Exercise	45	44	1	0					