


Wastewater Utility 2021 Monthly Report



June 2021

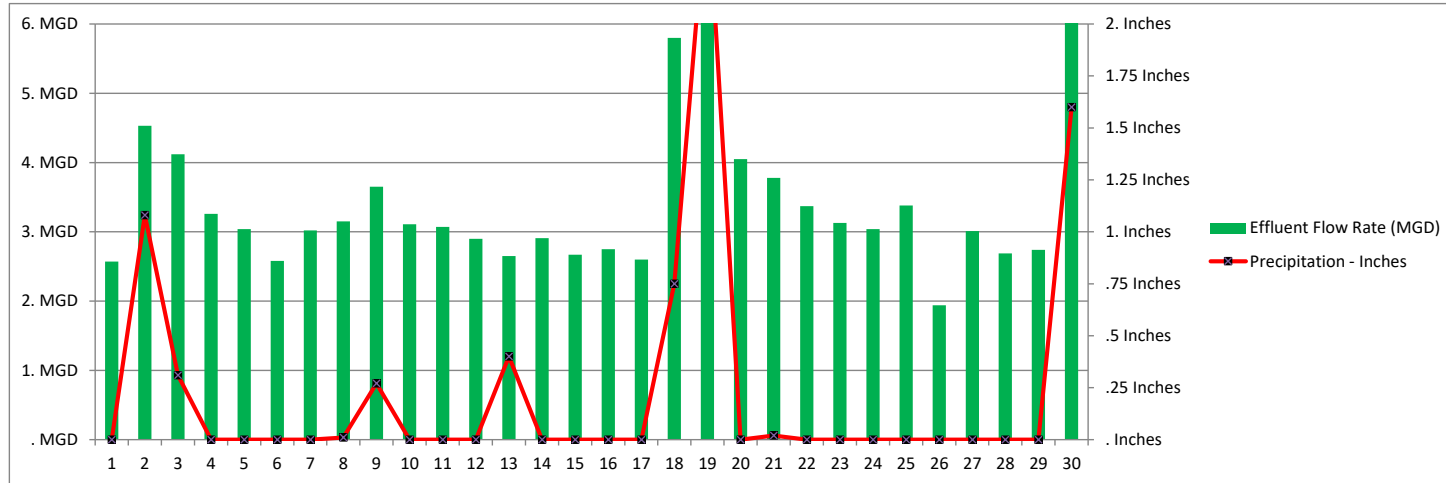

Month	January	February	March	April	May	June	July	August	September	October	November	December	Total
Total MG Treated Effluent 2021	93.67	91.88	123.06	84.84	99.19	104.57							597.21
Total MG Treated Effluent 2020	125.83	104.77	110.88	88.40	102.31	95.70	82.61	83.06	64.78	80.31	90.43	83.15	1112.23
Total Monthly Precipitation 2021	2.91	2.53	3.50	3.45	3.41	7.09							22.89
2021 Monthly Percent Capacity Actual Design Flow 4.0 MGD	76%	82%	99%	71%	80%	87%							83%

Sewer Crew Activities

1. Performed 24 lateral inspections
2. Completed routine maintenance and lift station checks.
3. Cleaned 1185' of sanitary main lines.
4. Responded to 5 service calls (sanitary).
5. Cleaned BWI/Progress Park and St. James N. lift stations.
6. Controller in Chapman lift station failed; able to get running on temp system. Ordered new controller, should be in soon.
7. Finished up job on Mill Street for Depot Grill.
8. Videoed mains before and after building move on SR 9 (Van Trees).
9. Repaired/replaced 4 catch basins.
10. Cleaned catch basins 2x.
11. Finished hauling out scrap from building demos.

Plant Crew Activities

- Sludge Pressed / Gallons: 447,000**
- Plant Operations and Maintenance:**
1. Completed required monthly maintenance.
 2. Hauled out 38.5 tons of bio-solids.
 3. Buckeye completed minor annual service and load bank test on plant generator and fixed the fuel control monitor.
 4. Replaced cooling fan in raw sewage pump control panel.
 5. Replaced motor on headworks dumpster auger.
 6. Removed fence around old animal management and put in storage.