


Wastewater Utility 2021 Monthly Report

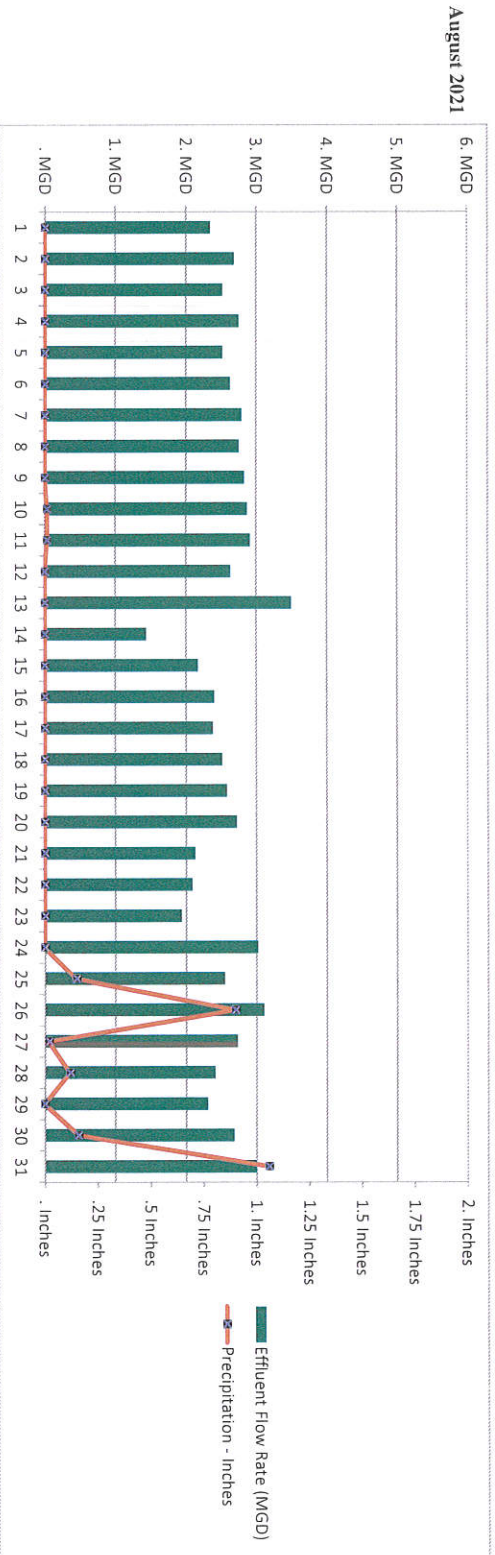

Month	January	February	March	April	May	June	July	August	September	October	November	December	Total
Total MG Treated Effluent 2021	93.67	91.88	123.06	84.84	99.19	104.57	134.73	79.89	64.78	80.31	90.43	83.15	811.83
Total MG Treated Effluent 2020	125.83	0.00	110.88	88.40	102.31	95.70	82.61	83.06	64.78	80.31	90.43	83.15	1007.46
Total Monthly Precipitation 2021	2.91	2.53	3.50	3.45	3.41	7.09	7.37	2.43					32.69
2021 Monthly Percent Capacity	76%	82%	99%	71%	80%	87%	109%	64%					84%
Actual Design Flow 4.0 MGD													

Sewer Crew Activities

1. Performed 14 lateral inspections
2. Completed routine maintenance and lift station checks.
3. Cleaned catch basins.
4. Had issues with pumps at Chapman and Waterview lift stations.
5. Replaced the impeller on pump #2 in Chapman; put spare in at Waterview.
6. Continued having issues at St. James north; currently working with contractors to determine best course of action.
7. Helped fire department with their training area at Station #2.
8. Picked up camera truck after repairs.
9. Cleaned up tree line along new access drive.
10. Installed gate at new entrance off Davis Road.
11. Helped plant operator with primary issues.

Sludge Pressed / Gallons:

737,000

Plant Crew Activities

1. Completed required monthly maintenance.
2. Hauled out 217 tons of bio-solids.
3. Repaired water line on the fine screen.
4. Repaired flow meter on one of our belt presses.
5. Dumpster auger repair was completed by Maddox.
6. Installed new plant water pump and motor.
7. Currently have 2 primary clarifiers out of service for repairs.