



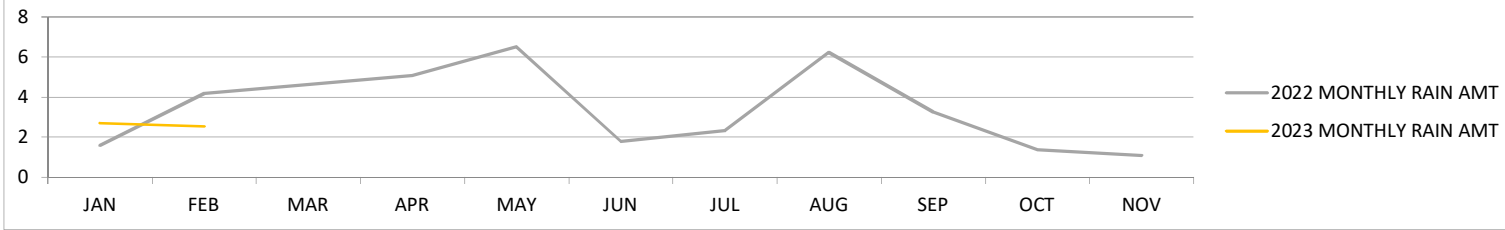

2023 Monthly Report

Water Utility

FEBRUARY

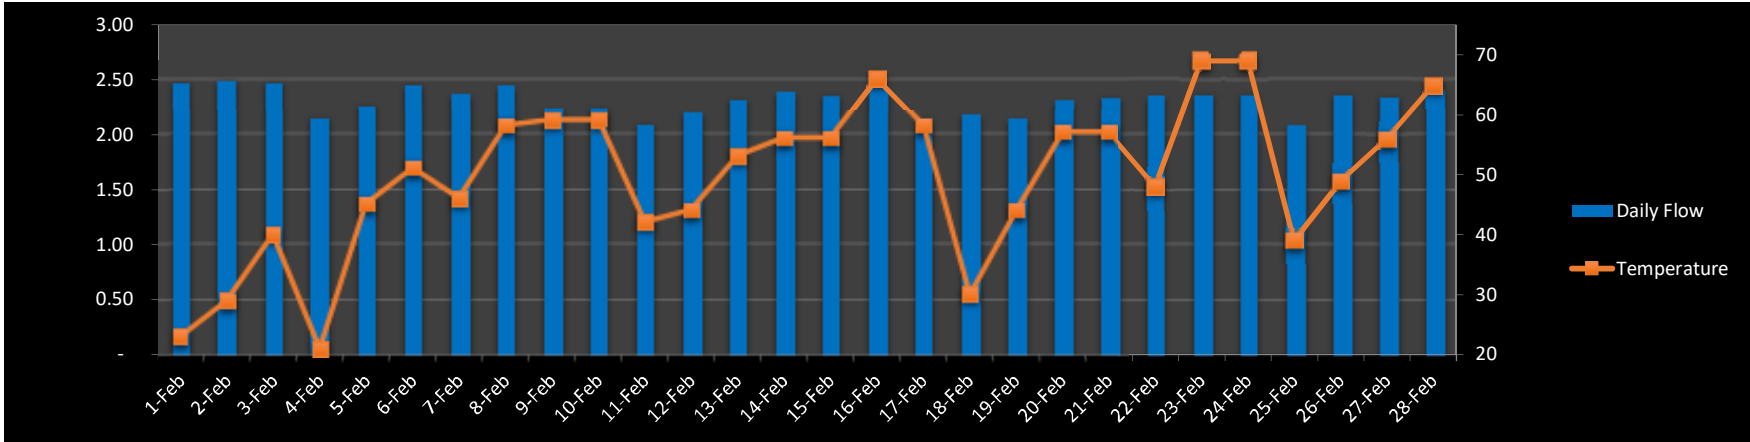

- Normal production
- Single main break / service leak
- Mutiple Main breaks
- Fire
- Flushing

Treatment

Water produced	64.73
Water Sold	77.43
Storage	131%
% Unaccounted	16%
Max Day	2.50
Prev Month connections:	9318
Current Month connections:	9340
average distirbution chlorine	0.65
AverageTreatment Phosphate	1.41
Average Treatment Iron	0.08
Average Treatment Maganese	0.04

OT, non- & Scheduled

Overtime, Non scheduled	64.73
Overtime, scheduled	77.43
Non-scheduled OT events	
ECO- Customer Service	131%
ECO- Distribution	16%
ECO- Treatment	2.50
ECO- Fire response / support	9318
Scheduled overtime events	
Distribution Project work	9340
Plant Operations	0.65
	1.41
	0.08
	0.04

Work Order summary

4	Construction / Repair	9
50.5	Performed Leak Notifications	44
	After hours Customer Service calls	17
4	Hydrant painting	23
	GIS Modifications	7
	Planning reviews and Technical Assistance	2
	Working on Well site reconaissance	1
	Valve Maintenance	28
	Hydrant flushing	40
50.5		