
Wastewater Utility 2023 Monthly Report



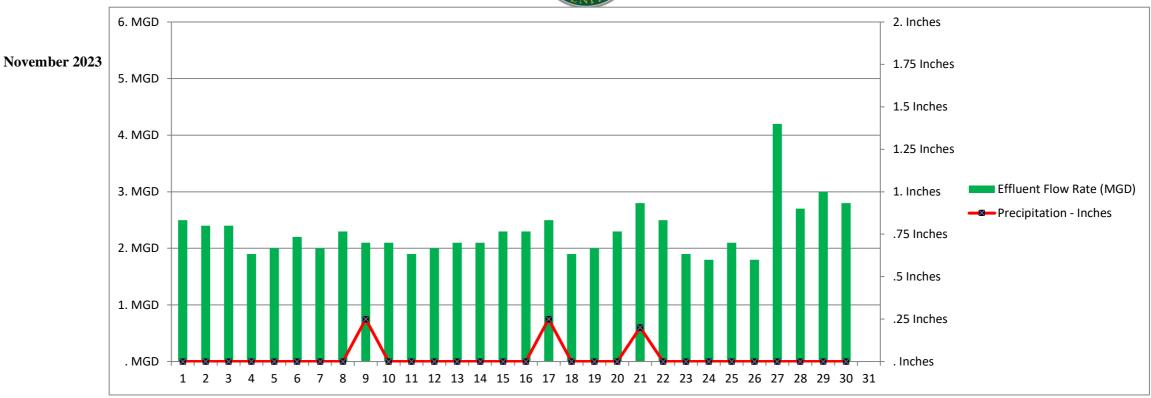

Month	January	February	March	April	May	June	July	August	September	October	November	December	Total
Total MG Treated Effluent 2023	119.40	96.16	164.80	95.29	88.73	67.40	85.80	89.80	70.30	70.60	68.90		1017.18
Total MG Treated Effluent 2022	107.08	132.88	140.54	120.85	123.71	86.77	72.59	84.83	81.02	69.45	67.96	77.22	1164.90
Total Monthly Precipitation 2023	3.40	2.29	7.39	2.40	1.32	1.39	5.68	5.03	1.01	3.36	0.70		33.97
Total Monthly Precipitation 2022	1.97	5.87	4.9	4.52	7.72	2.05	2.43	6.55	3.13	1.41	2.25	3.58	46.38
				<u> </u>					-				
2023 Monthly Percent Capacity	96%	86%	133%	79%	72%	56%	69%	72%	59%	57%	57%		76%
Actual Design Flow 4.0 MGD		•	•			•	•						

Sewer Crew Activities

- 1. Performed 22 lateral inspections.
- 2. Completed routine lift station checks.
- 3. Installed 2 new sanitary manholes.
- 4. Completed video inspection of 40' of sanitary mains.
- 5. Repaired/replaced 465' of sanitary mains.
- 6. Cleaned 8010' of sanitary mains.
- 7. Responded to 3 service calls.

Plant Crew Activities

Sludge Pressed / Gallons: 534,700

Plant Operations and Maintenance:

- 1. Completed required monthly maintenance.
- 2. Hauled313 tons of Class A bio-solids to farmers and 204 tons of pressed sludge to the landfill.
- 3. Shut the disinfection system for the year and winterized lines.
- 4. Verfied oil levels and checked for contamination in the raw sewage pumps.
- 5. Pulled motor from Digester Blower #2 and sent in for inspection/repair.

Monthly Overtime									
WWTP Operators				Collection System Operators					
Scheduled: weekends, holidays	Emergency Call Ins	Riley Festival	Unscheduled	Emergency Call Ins	Riley Festival				
66	8	0	4.25	10	0				
Total Dept. Overtime:	88.25								